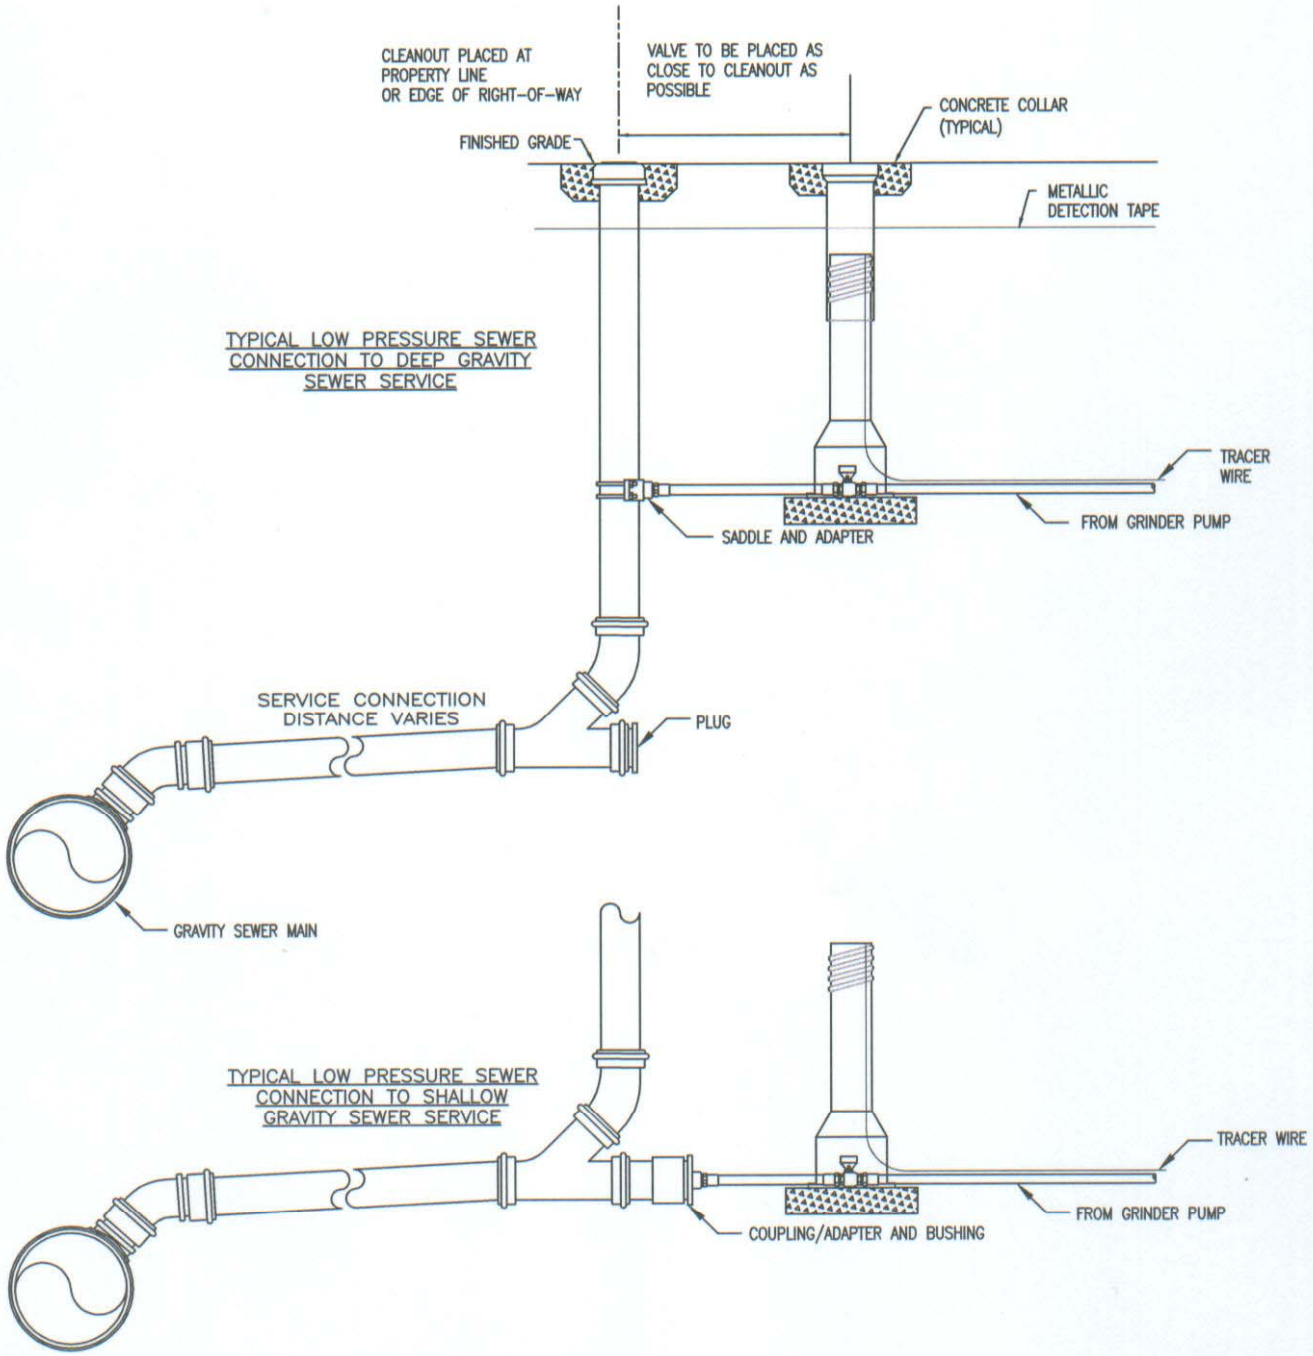

NOTES:

CLEANOUT SHALL BE INSTALLED UTILIZING THE APPLICABLE STANDARD DETAIL AS DIRECTED BY THE ENGINEER.

SERVICE VALVE ASSEMBLY SHALL BE INSTALLED IN ACCORDANCE WITH METCOM STANDARD P-1.

DEPTH OF PRESSURE SEWER SHALL NOT EXCEED 5'6".

St. Mary's County Metropolitan Commission Since 1964 Potable Water Distribution Wastewater Treatment	**APPROVED** C. I. FREDERICK JR., P.E. CHIEF ENGINEER DATE: 7/1/09	**REVISIONS** DATE: 6/18/09 — INITIALS: J.E.C.	*ST. MARY'S COUNTY METROPOLITAN COMMISSION* ***STANDARDS FOR PUBLIC WATER, SEWER AND INCIDENTAL STRUCTURES*** LOW PRESSURE SEWER CONNECTION TO NEW OR EXISTING GRAVITY SEWER SERVICE **STANDARD NO. P-10**