




CONCRETE DRIVEWAY

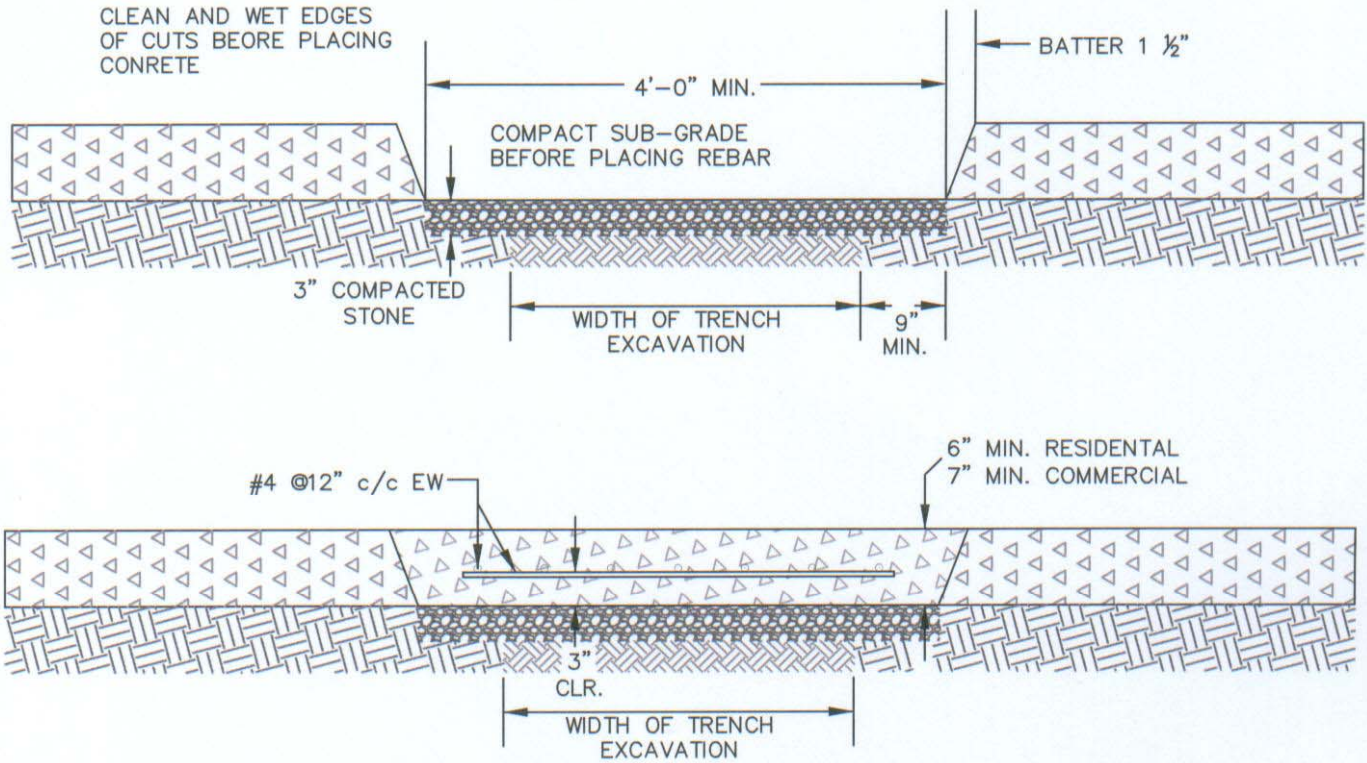

NOTE:
 ALL CONCRETE SHALL BE MDOT SHA MIX #2, 3000 psi@28 DAYS.

PRIOR TO PLACING CONCRETE , ALL UTILITY STRUCTURES SHALL BE BROUGHT TO GRADE. BACKFILL AROUND UTILITY STRUCTURES WITH APPROVED MATERIAL.

REMOVE EXISTING CONCRETE DRIVEWAY TO THE NEAREST JOINT WHEN SO DIRECTED BY THE ENGINEER.

	APPROVED	REVISIONS		ST. MARY'S COUNTY METROPOLITAN COMMISSION STANDARDS FOR PUBLIC WATER, SEWER AND INCIDENTAL STRUCTURES
	 C. I. FREDERICK JR., P.E. CHIEF ENGINEER	DATE	INITIALS	
	DATE: <u>7/1/09</u>	6/18/09	J.E.C.	