


Note: Drawing not to scale. Pumps not shown. Plan is one of several possible layouts and is for illustrative purposes only.



Note: Dry Well Minimum Size 14'X16'

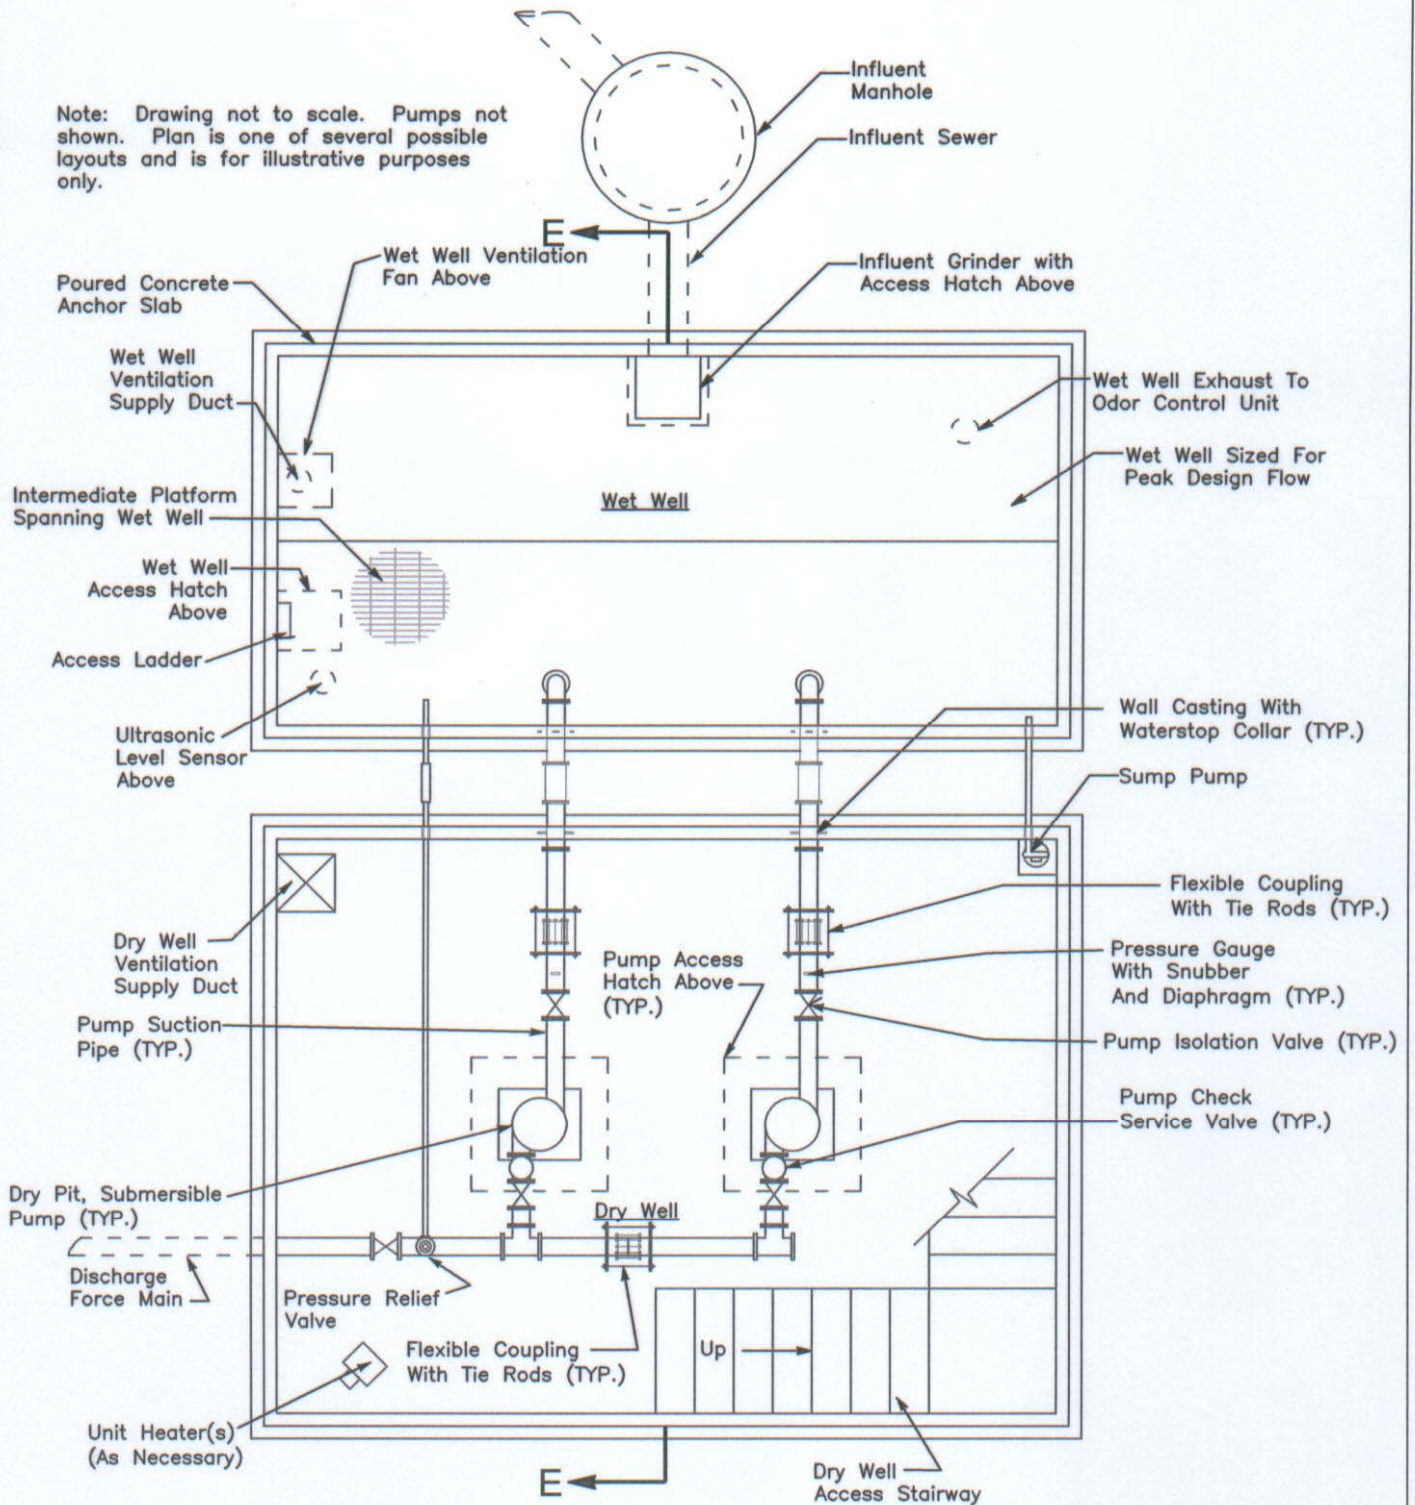

APPROVED

C.F.

C. I. FREDERICK JR., P.E.
CHIEF ENGINEER

DATE: 7/1/09

REVISIONS

DATE	INITIALS
6/18/09	J.E.C.

ST. MARY'S COUNTY
METROPOLITAN COMMISSION
STANDARDS FOR PUBLIC WATER, SEWER
AND INCIDENTAL STRUCTURES

Package Wastewater Pumping Station
Wet Well and Dry Well Plan

STANDARD NO. PS-14