



CLEANOUT PLACED AT PROPERTY LINE  
OR EDGE OF RIGHT-OF-WAY

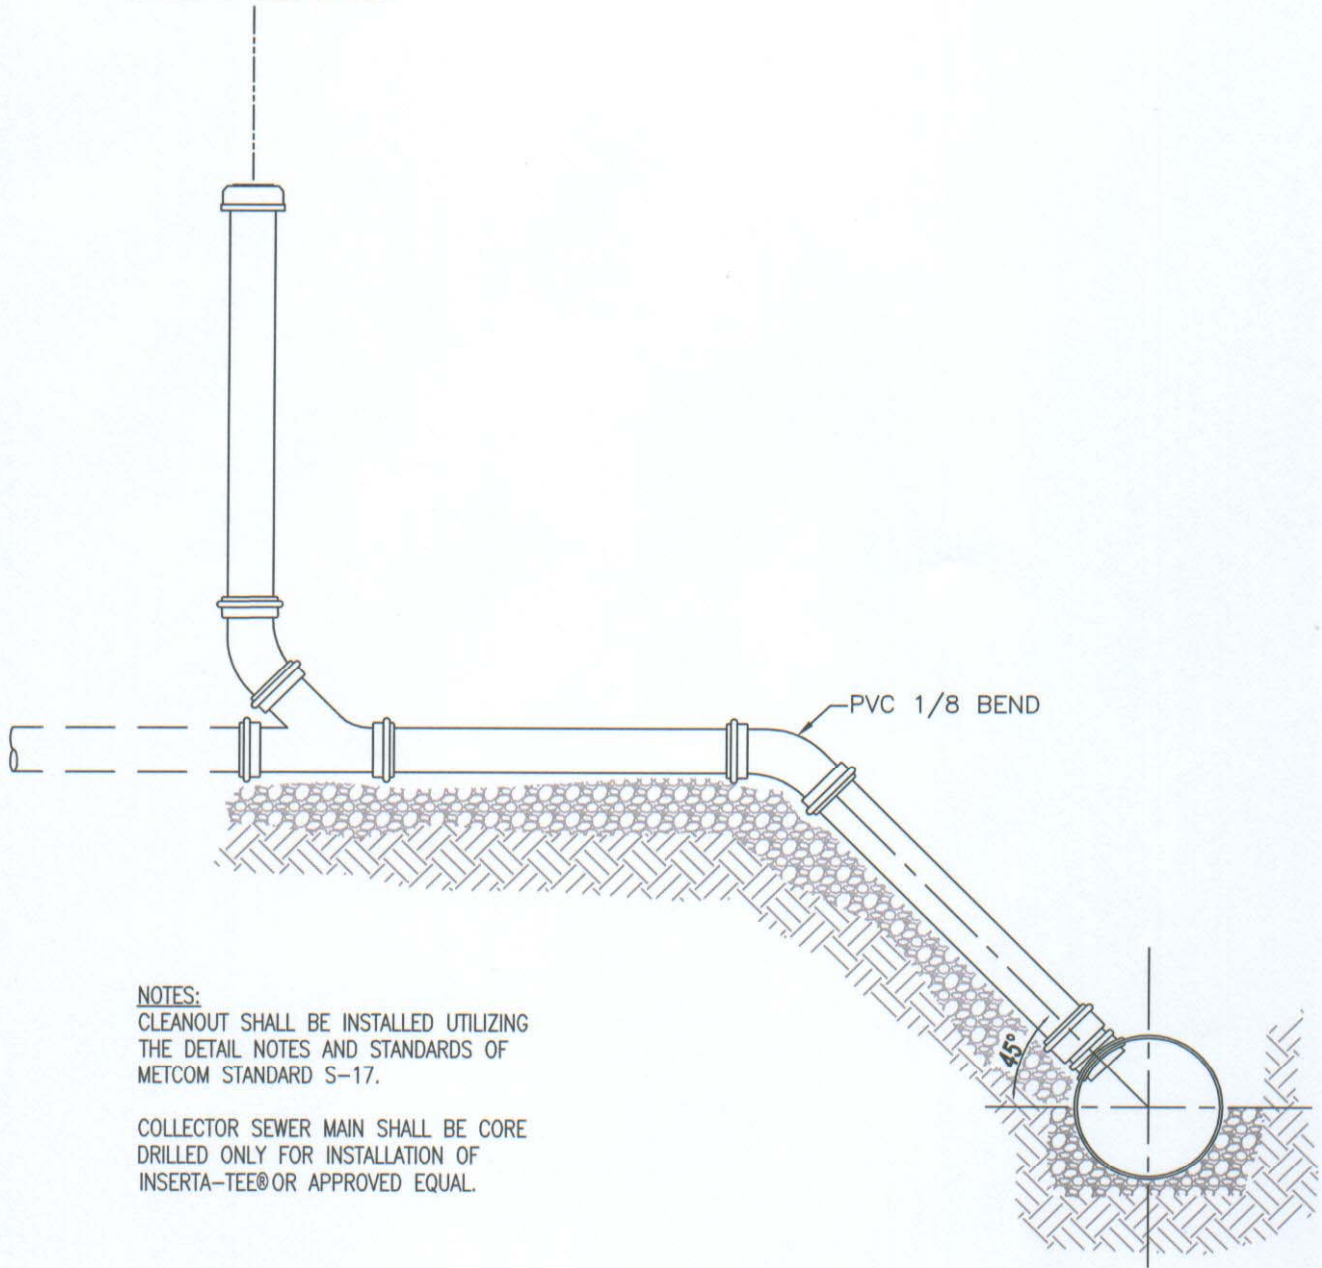

**NOTES:**  
CLEANOUT SHALL BE INSTALLED UTILIZING  
THE DETAIL NOTES AND STANDARDS OF  
METCOM STANDARD S-17.

COLLECTOR SEWER MAIN SHALL BE CORE  
DRILLED ONLY FOR INSTALLATION OF  
INSERTA-TEE OR APPROVED EQUAL.



**APPROVED**

*C.I.F.*

C. I. FREDERICK JR., P.E.  
CHIEF ENGINEER

DATE: 7/1/09

REVISIONS	
DATE	INITIALS
6/18/09	J.E.C.

**ST. MARY'S COUNTY  
METROPOLITAN COMMISSION**  
STANDARDS FOR PUBLIC WATER, SEWER  
AND INCIDENTAL STRUCTURES

**SINGLE SERVICE  
CONNECTION TO EXISTING  
LARGE DIAMETER SEWER >12"**

**STANDARD NO. S-16**