



PLAN

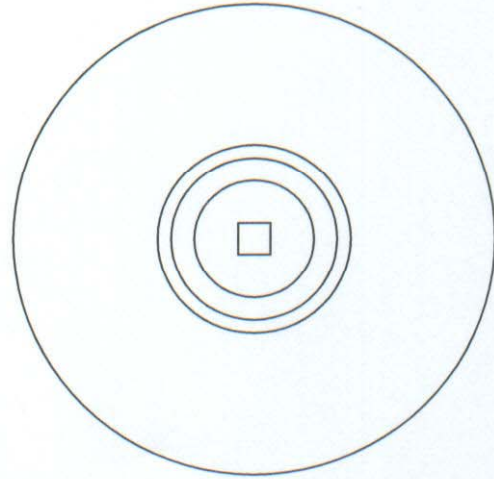

Concrete collar  
(18" X 18" X 6")

Concrete collar  
(18" Circular X 6")

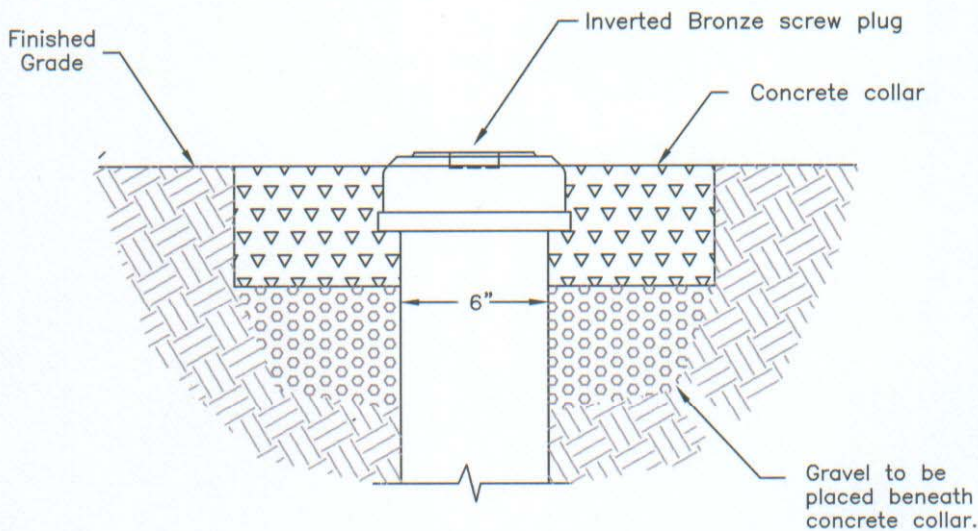

ELEVATION

Notes:

Panella style cap shall be made of cast or ductile iron with a bronze screw plug and have an integral watertight gasket to seal against the outer wall of the pipe.

Concrete shall be MDOT SHA Mix #1

	<b>APPROVED</b>	<b>REVISIONS</b>		<b>ST. MARY'S COUNTY METROPOLITAN COMMISSION</b> STANDARDS FOR PUBLIC WATER, SEWER AND INCIDENTAL STRUCTURES
	 C. I. FREDERICK JR., P.E. CHIEF ENGINEER DATE: <u>7/1/09</u>	DATE	INITIALS	
		6/18/09	J.E.C.	