


Typical Setting

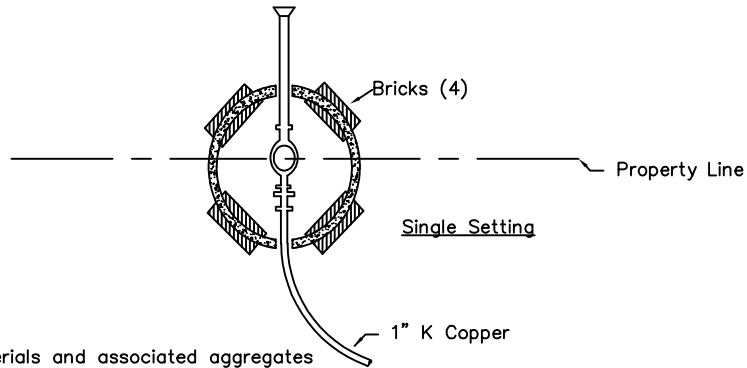

Single Setting

All materials and associated aggregates shall be in accordance with the Material Specifications Section as most recently revised.

All copper connections shall be flared.

Meter setter shall be appropriately sized and shall include the lockable angle valve on the inlet side of the meter and the dual cartridge check valve on the discharge side of the meter.


Plastic pit setter shall have a minimum diameter of 18" and shall be round.

Plastic pit setter shall have a minimum height of 30" without the meter lid frame installed.


Plastic pit setter shall not be placed in an area subject to vehicular traffic.

Meter placed in an area subject to vehicular traffic will require the approval of the Engineer.

Corporation stop may be tapped directly into a ductile iron main with the approval of the Engineer.

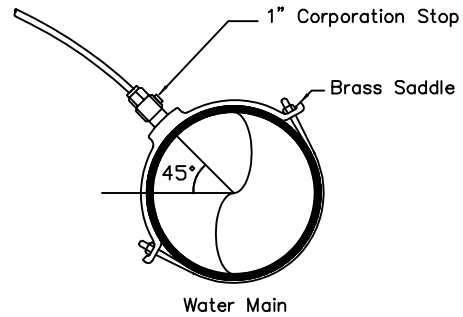

Meter located within 3 feet of a driveway shall have the lid assembly encased and supported with concrete.



**APPROVED**

*M. C. Hollander*

M. C. HOLLANDER, P.E.  
CHIEF ENGINEER

DATE: \_\_\_\_\_

**REVISIONS**

DATE	INITIALS
6/18/09	J.E.C.
2/5/19	J.E.C.

ST. MARY'S COUNTY  
METROPOLITAN COMMISSION  
STANDARDS FOR PUBLIC WATER, SEWER  
AND INCIDENTAL STRUCTURES

TYPICAL INSTALLATION OF  
SINGLE METER SETTING  
FOR DOMESTIC USE

**STANDARD NO. W-4A**