

Coppersetter shall be commercially manufactured.



All materials shall be in accordance with the Material Specifications Section as most recently revised.

Piping sizes shall be determined by the Engineer for required flows.

Meter setter shall include the lockable angle valve on the inlet side prior to the tee and dual cartridge check valves on the discharge side of the meter and fire line.

Installation shall be in accordance with Standard W-4B.

Meter pit shall be installed in accordance with Standard W-4B, W-5 and W-6.

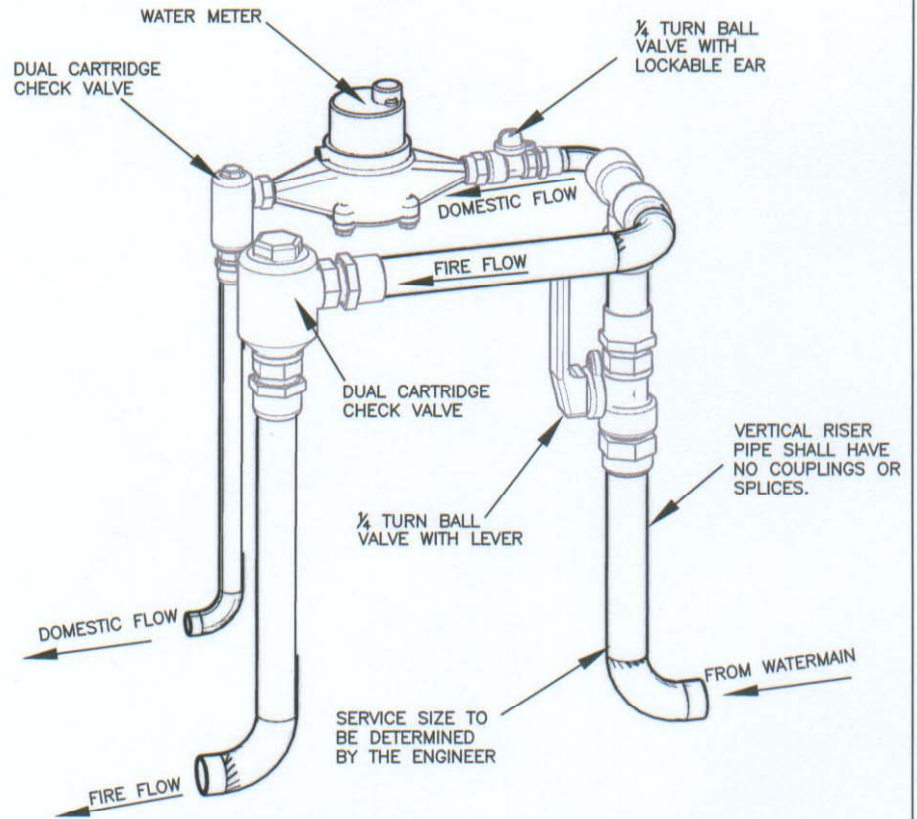

www.metcom.org

APPROVED

David J. Elberti
 DAVID J. ELBERTI, P.E.
 CHIEF ENGINEER

DATE: 5/11/11

REVISIONS

DATE	INITIALS
6/18/09	J.E.C.
5/5/11	J.E.C.

**ST. MARY'S COUNTY
 METROPOLITAN COMMISSION
 STANDARDS FOR PUBLIC WATER, SEWER
 AND INCIDENTAL STRUCTURES**

**SHARED DOMESTIC SUPPLY AND
 SPRINKLER CONNECTION
 (TYPICAL)**

STANDARD NO. W-13