

PROPERTY LINE

NOTES:

PRE-CAST SEWER BLOCK SHALL BE USED ON VERTICAL WYE


PLUGS SHALL BE SUFFICIENTLY BLOCKED TO WITHSTAND AIR OR WATER TEST

SERVICE LATERAL SHALL HAVE A MINIMUM SLOPE OF NO LESS THAN 2%


SERVICE LATERAL SHALL NOT EXCEED 100 FEET IN LENGTH BETWEEN CLEANOUTS

ADDITIONAL CLEANOUT(S) WHEN REQUIRED SHALL BE CONSTRUCTED IN THE SAME MANNER AS THE SERVICE CONNECTION SETTING.

2 ~ 6" 1/16 BENDS

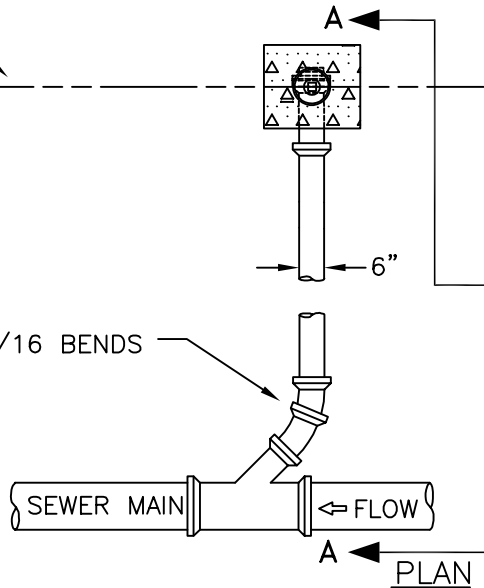

CONCRETE COLLAR AND PANELLA CAP SET FLUSH WITH FINISHED GRADE. SEE DETAIL S-17 OR S-18.



6" SANITARY TEE-WYE


6" PLUG *ALTERNATE CONNECTION

SADDLES SHALL NOT BE ACCEPTED

6" WYE AND 1/8 BEND

PRE-CAST SEWER BLOCK


6" PLUG TYPICAL CONNECTION



SECTION A-A PROFILE

SECTION A-A MATERIAL SAME AS MAIN

*ALTERNATE CONNECTION REQUIRES THE PRIOR APPROVAL OF THE ENGINEER.



APPROVED

M. C. Hollander

M. C. HOLLANDER, P.E.
CHIEF ENGINEER

DATE: 7/11/19

REVISIONS

DATE	INITIALS
6/18/09	J.E.C.
1/8/19	J.E.C.

ST. MARY'S COUNTY
METROPOLITAN COMMISSION
STANDARDS FOR PUBLIC WATER, SEWER
AND INCIDENTAL STRUCTURES

SEWER SERVICE CONNECTION
SINGLE SETTING

STANDARD NO. S-10