



Note:
 Drawing not to scale. Pumps not shown.
 Plan is one of several possible layouts
 and is for illustrative purposes only.

Dry-prime pump may be substituted with
 a generator with the approval of the
 Engineer.

Asphalt parking and drive shall be
 constructed in accordance with Standard
 Detail G-23 or as directed by the
 Engineer.

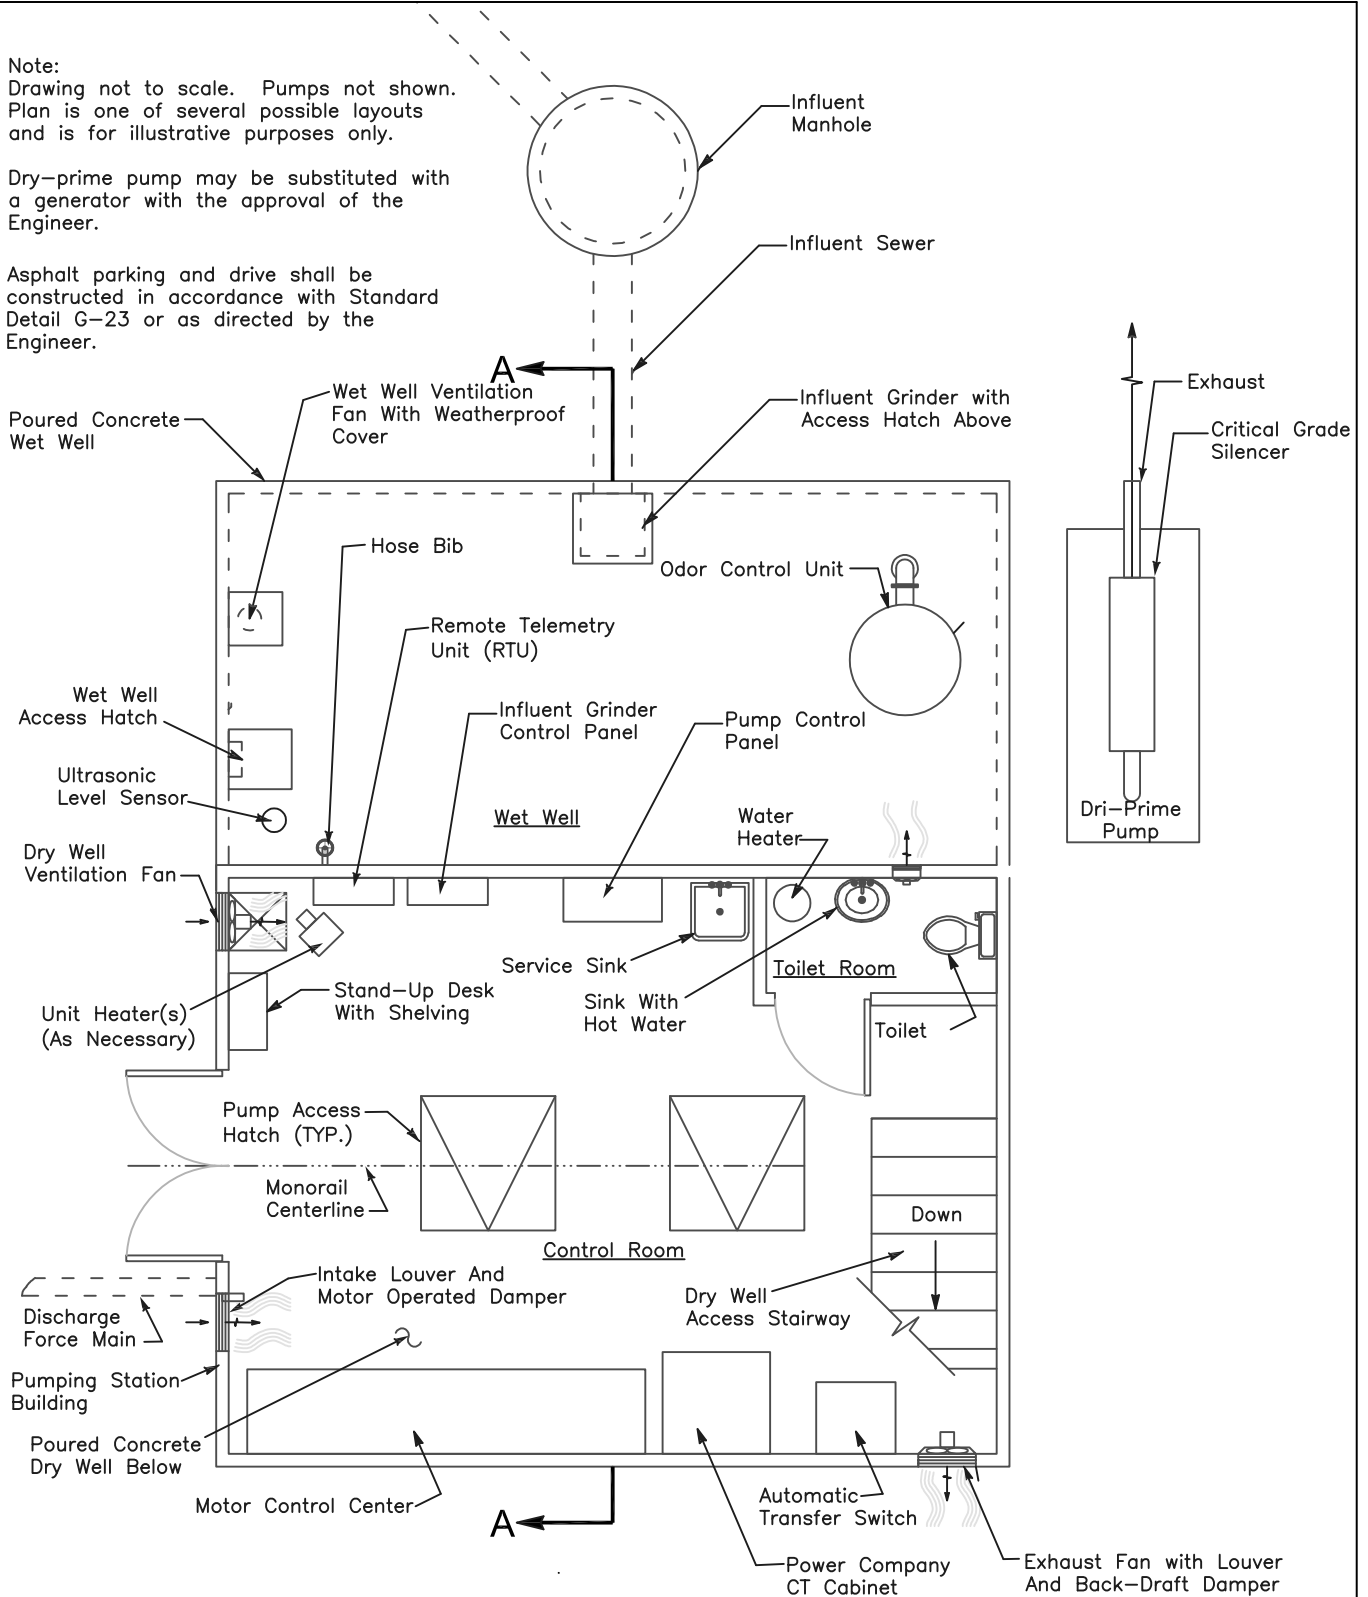

Note: Control Room Minimum Size 14'X16'



APPROVED

M. C. Hollander

M. C. HOLLANDER, P.E.
 CHIEF ENGINEER

DATE: 7/11/19

REVISIONS	
DATE	INITIALS
6/18/09	J.E.C.
1/16/19	J.E.C.

**ST. MARY'S COUNTY
 METROPOLITAN COMMISSION**

**STANDARDS FOR PUBLIC WATER, SEWER
 AND INCIDENTAL STRUCTURES**

Typical Plan For
 Wastewater Pumping Station

STANDARD NO. PS-1