



*Drawing is not to scale. Plan is one of several possible layouts and is for illustrative purposes only.

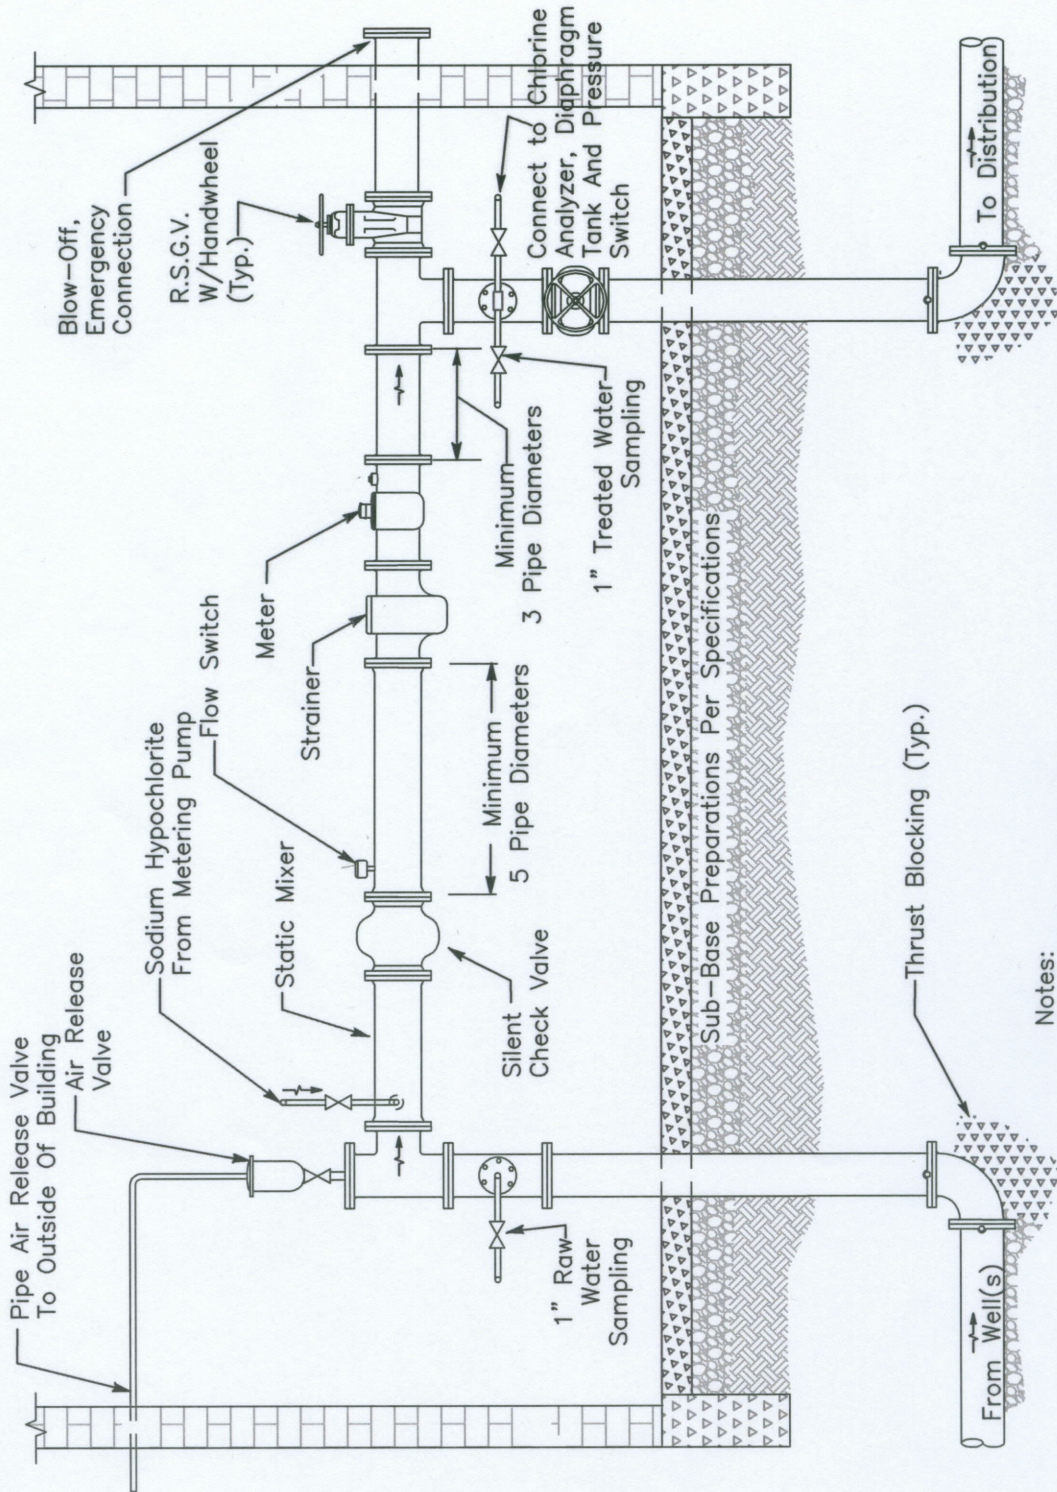

- Notes:
1. All piping shall be ductile iron.
 2. Mechanical joints beneath floor shall be restrained.
 3. Interior piping shall be flanged.
 4. All building penetrations shall be sealed with hydraulic grout.
 5. Provide pipe supports as required.



APPROVED

C. I. FREDERICK JR., P.E.
CHIEF ENGINEER

DATE: 7/26/10

REVISIONS

DATE	INITIALS
6/18/09	J.E.C.
7/26/10	J.E.C.

ST. MARY'S COUNTY
METROPOLITAN COMMISSION
STANDARDS FOR PUBLIC WATER, SEWER
AND INCIDENTAL STRUCTURES

Typical Water Pumping Station
Pumping to System Or Tower
Section A-A

STANDARD NO. WP-2